


G:\TXN\Projects\City_Coppell\3451-03_RedundancyStudy\10_GIS\Exhibits\7898_02_Grapevine_Coppell\7898_02_Grapevine_Coppell.aprx




LOCATION 2
Connect Coppel 12" WL to Grapevine 12" WL
at TX-121 & Northpoint Dr
Interconnect Vault and Approx. 1,300 LF 12" Water line
in Easement Adjacent to TX-121 ROW.

LOCATION 1
Connect Coppel 16" WL to Grapevine 12" WL
at W. Bethel Rd. & Creekview Dr.
Interconnect Vault and Approx. 1,300 LF 12" Water line
in W. Bethel Rd. ROW (Parkway)

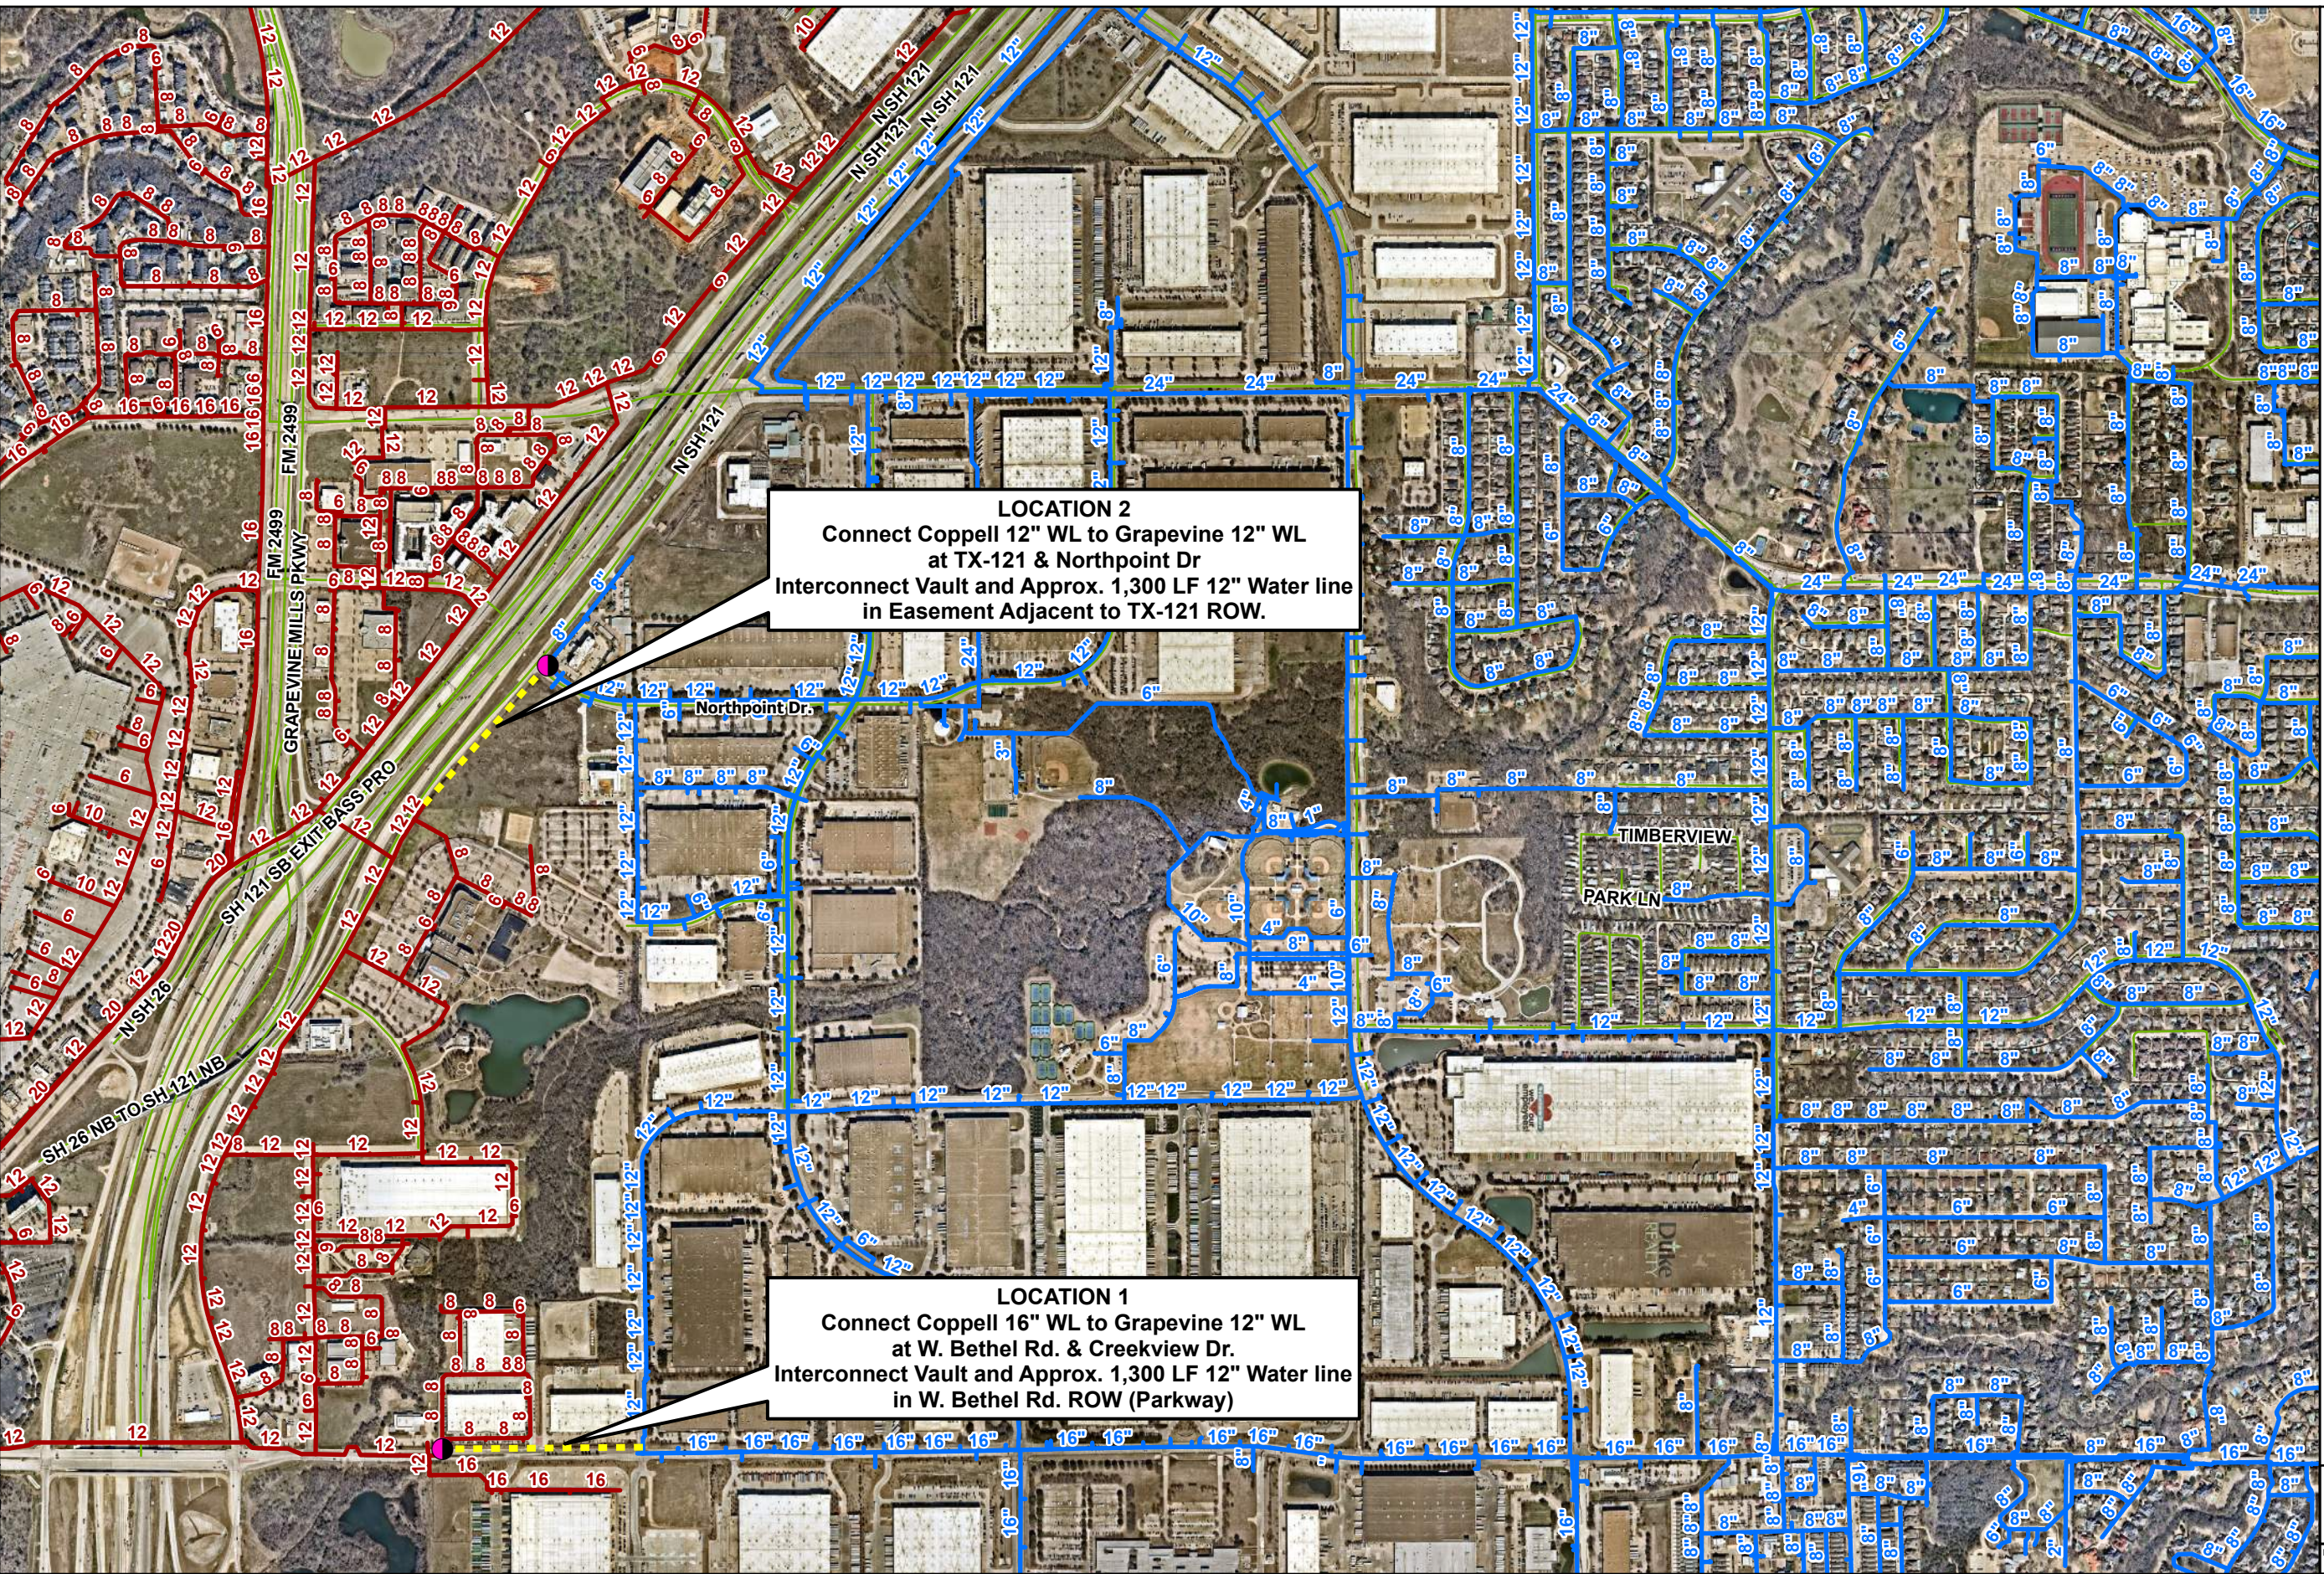

- Proposed Interconnect
- Coppel Waterlines
- Grapevine Waterlines
- Flow Control Valve



Disclaimer:
Every effort has been made to ensure the accuracy of the basemap data. BGE, Inc. assumes no liability or damages due to errors or omissions.

EXHIBIT

Date: April 2022 Job No: 7898-02

Grapevine - Coppel Interconnect Options Overall

BGE, Inc.
Tel: 972-464-4800
www.bgeinc.com