


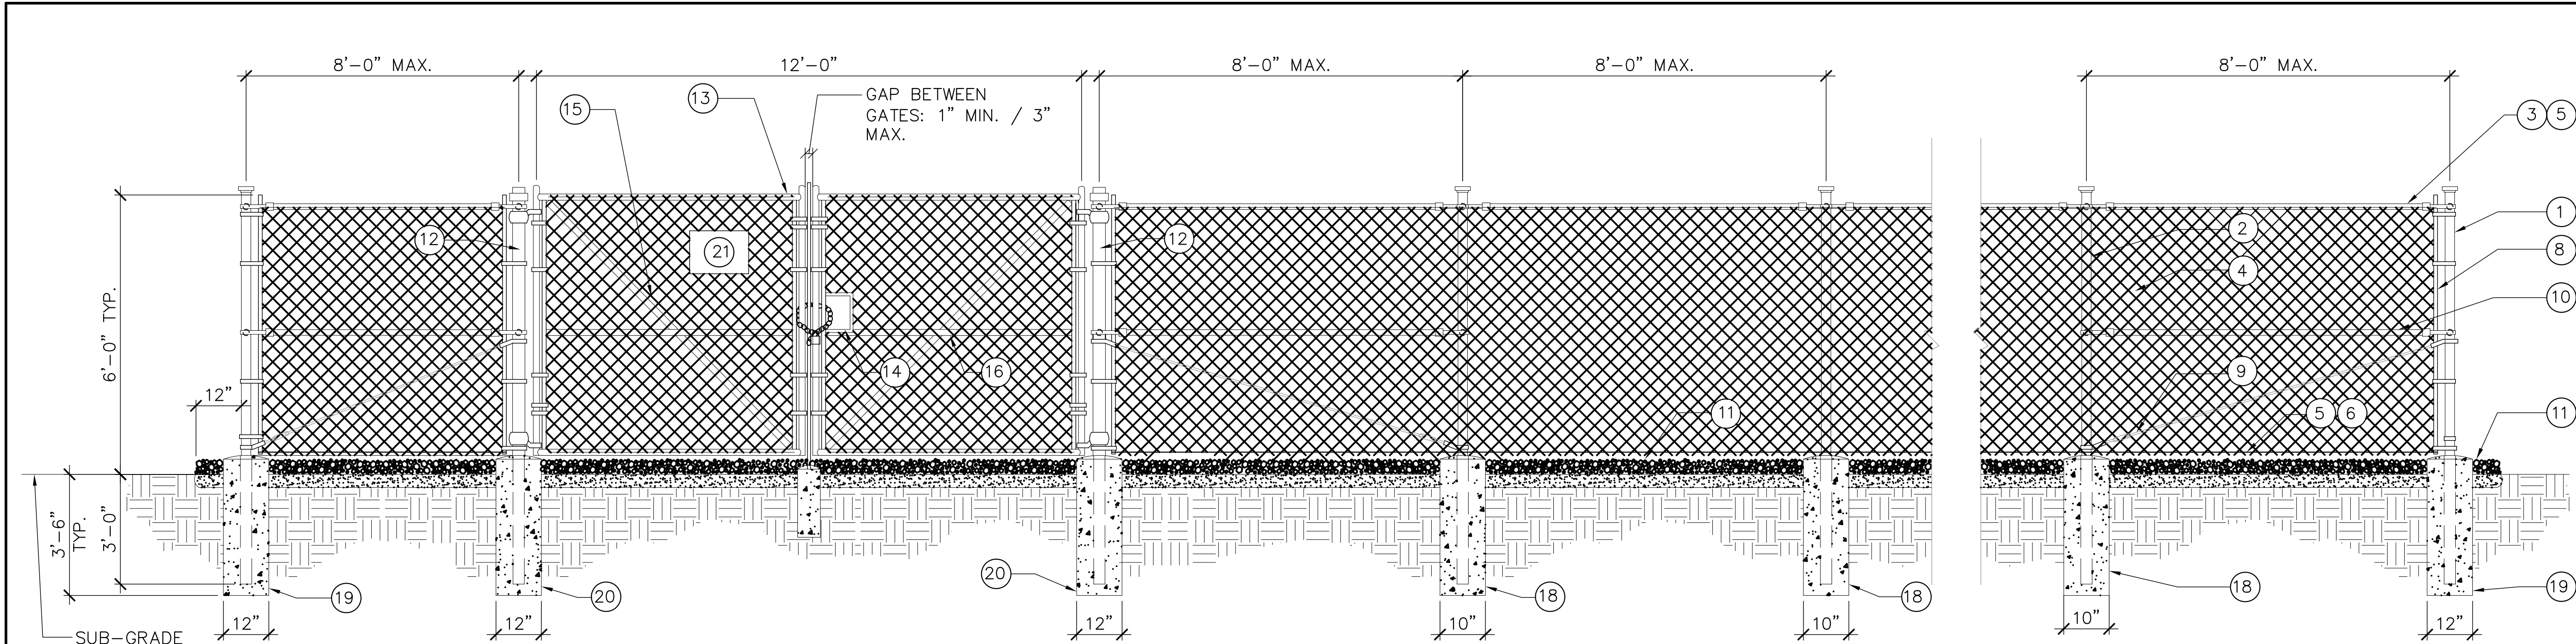


2 6' CHAIN LINK FENCE DETAIL
SCALE : NTS

REFERENCE NOTES:

1. CORNER, END OR PULL POST: 3" NOMINAL SCHEDULE 40 PIPE.
2. LINE POST: 2 1/2" SCHEDULE 40 PIPE, PER ASTM F1083. LINE POSTS SHALL BE EQUALLY SPACED AT MAXIMUM 8'-0" O.C.
3. TOP RAIL & BRACE RAIL: 1 1/2" PIPE, PER ASTM F1083.
4. FABRIC: 9 GAUGE CORE WIRE SIZE 2" MESH, CONFORMING TO ASTM A392.
5. TIE WIRE: MINIMUM 11 GAUGE PVC. A SINGLE WRAP OF FABRIC TIE AT POSTS AND RAILS. BY HOG RINGS SPACED MAXIMUM 24" INTERVALS AT TENSION WIRE.
6. TENSION WIRE: 9 GAUGE PVC.
7. NOT USED.
8. STRETCHER BAR: 3/16" X 3/4" X HEIGHT OF FENCE.
9. 3/8" DIAGONAL ROD WITH PVC TURNBUCKLE OR DIAGONAL THREADED ROD.
10. CORNER POST BRACE: 1 5/8" DIA. EACH CORNER EACH WAY.
11. FINISH GRADE SHALL BE UNIFORM, LEVEL AND EXTEND 12" BEYOND FENCE BOUNDARY.
12. GATE POST: 4" SCHEDULE 40 PIPE, FOR GATE WIDTHS UP THRU 10 FEET OR 20 FEET FOR DOUBLE SWING GATE, PER ASTM F1083.
13. GATE FRAME: 1 1/2" PIPE, PER ASTM F1083.
14. 4" X 6" HANDHOLD WITH 3/4" CHAIN AND LOCKS. WELD CHAIN TO THE GATE LEAF WITHOUT THE HANDHOLD.
15. GATE DIAGONAL: PVC 1 1/2" PIPE.
16. GATE FRAME BRACE: 1 5/8" DIAMETER.
17. NOT USED
18. LINE POST CONCRETE FOUNDATION (2000 PSI).
19. CORNER POST CONCRETE FOUNDATION (2000 PSI).
20. GATE POST CONCRETE FOUNDATION (2000 PSI).
21. SIGNAGE PROVIDED BY OWNER.


GENERAL NOTES:

1. INSTALL FENCING PER ASTM F567.
2. INSTALL SWING GATES PER ASTM F900.
3. COMPLY WITH LOCAL ORDINANCE OF BARBED WIRE PERMIT REQUIREMENT, IF REQUIRED.
4. POST & GATE PIPE SIZES ARE INDUSTRY STANDARDS. ALL PIPE TO BE 1-1/4" NOMINAL SCHEDULE 40 GALVANIZED MINIMUM (HOT DIP, ASTM F1083 GRADE "A" STEEL). ALL GATE FRAMES SHALL BE WELDED. ALL WELDING SHALL BE COATED WITH (3) COATS OF COLD GALVANIZING (OR EQUAL).
5. ALL OPEN POSTS SHALL HAVE END-CAPS.
6. USE GALVANIZED HOG-RING WIRE TO MOUNT ALL SIGNS.
7. ALL SIGNS MUST BE MOUNTED ON INSIDE OF FENCE FABRIC.

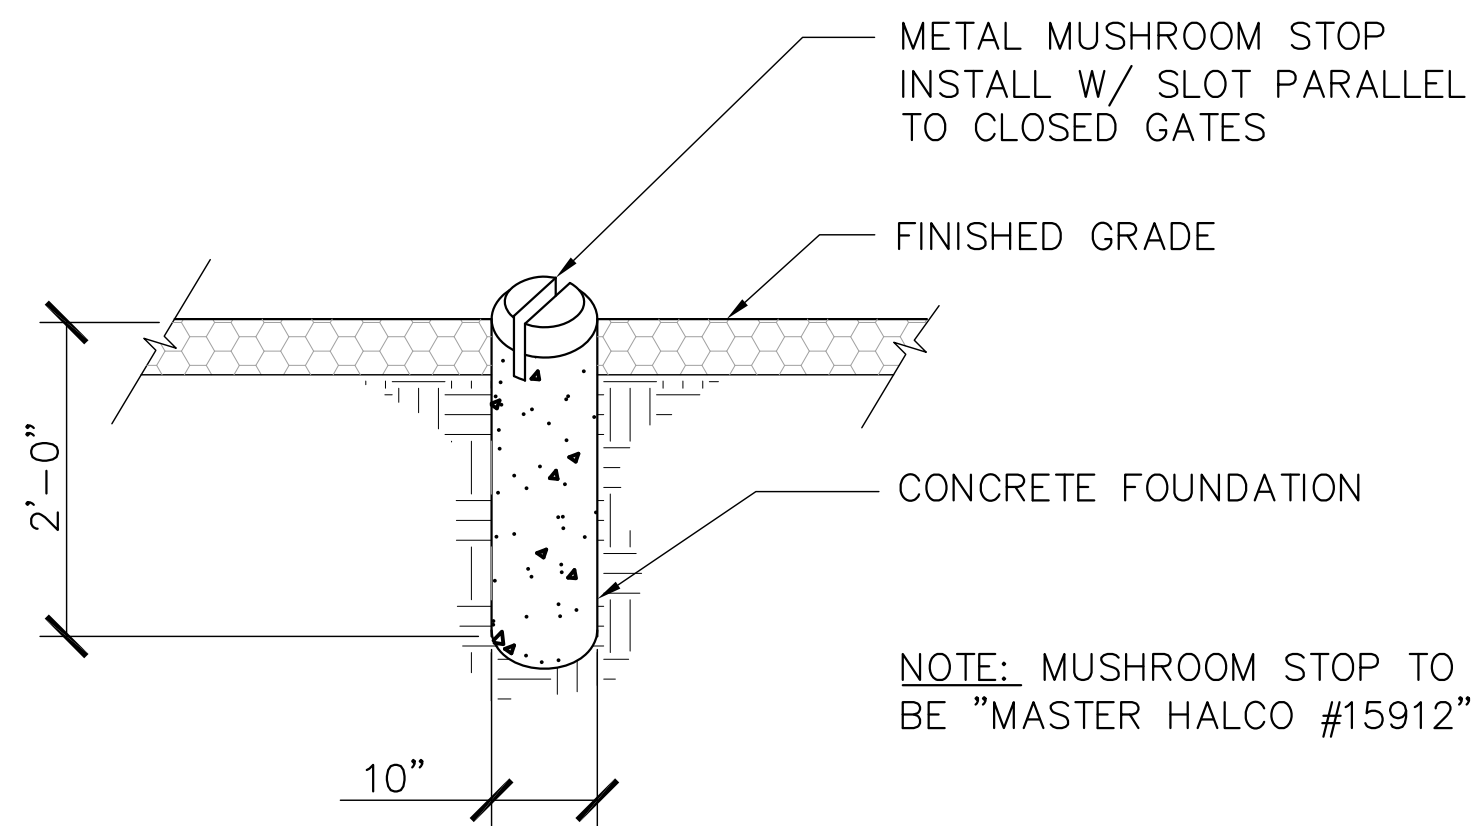

1 MUSHROOM GATE STOP
SCALE: NTS


NO.	DATE	ISSUED FOR REVIEW	CITY COMMENTS
F	04/21/15		CITY COMMENTS
E	04/06/15		CITY COMMENTS
D	03/31/15		CITY COMMENTS
C	03/17/15		CITY COMMENTS
B	01/28/15		ISSUED FOR REVIEW
A	9/30/14		ISSUED FOR REVIEW

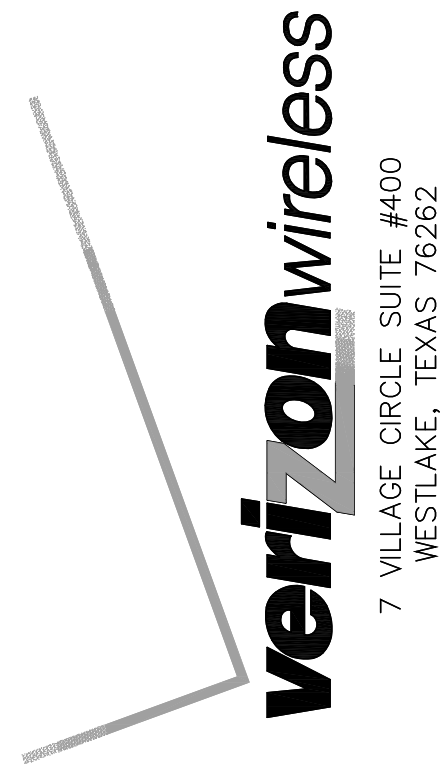

DATE DRAWN: 9/30/14	DRAWN BY: J. C. VOIGT	APPROVED BY: J. GEORGE
------------------------	--------------------------	---------------------------

NEW SITE BUILD
SANDY LAKE

SITE # ID 301560
1005 E SANDY LAKE RD
COPPELL, TX 75019
DALLAS COUNTY

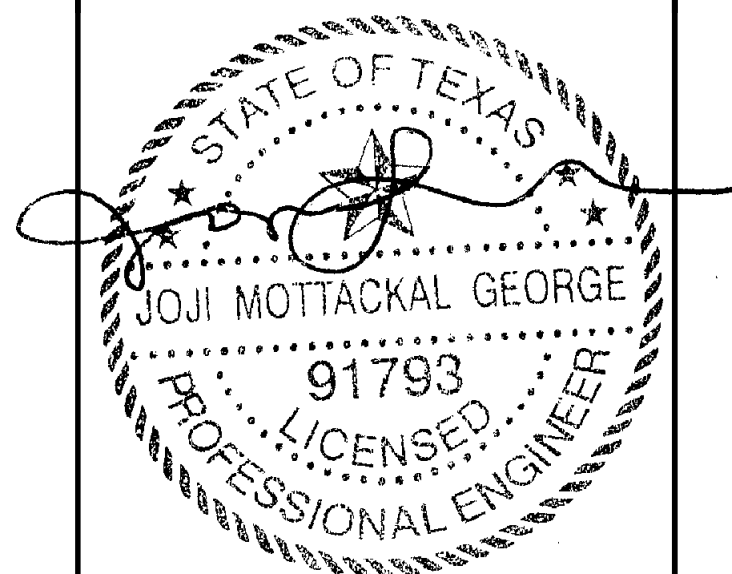

SHEET NAME

WALL DETAILS

SHEET NUMBER

C-8