
Exhibit C Page 1 of 3

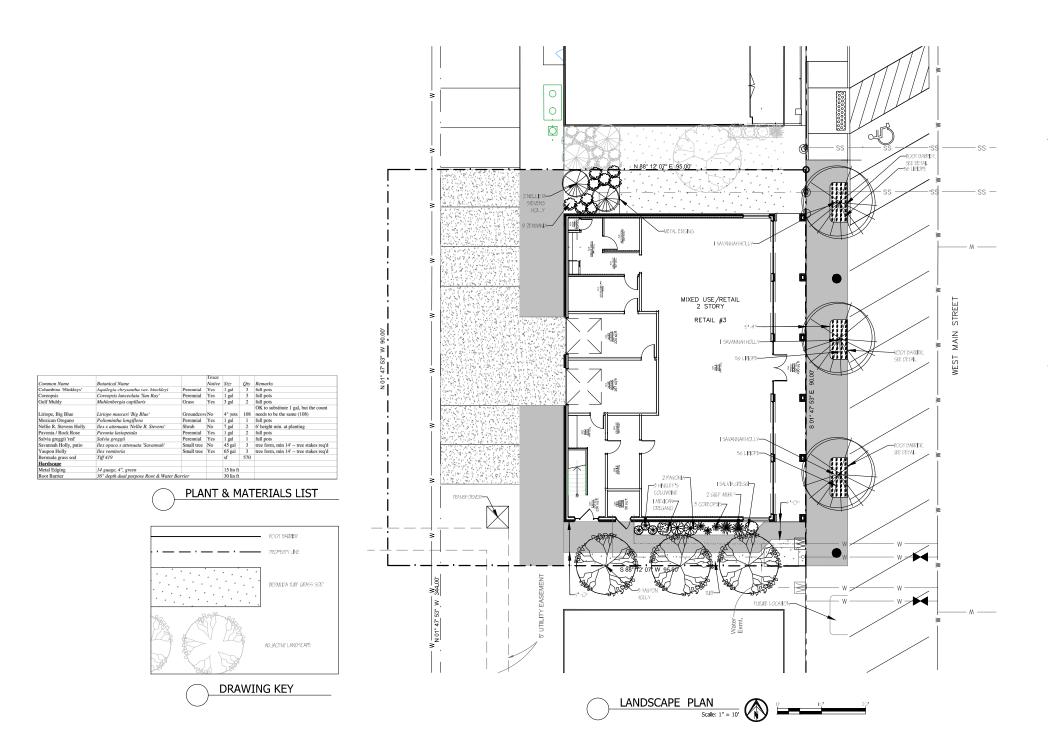

# Jurisdiction of Project

CITY OF COPPELL PLANNING & ZONING 255 PARKWAY BLVD. PO BOX 9478 COPPELL, TX 75019 972 304-7092

TEXAS DEPARTMENT OF LICENSING AND REGULATION ELMINATION OF ARCHITECTURAL BARRIERS E.O. THOMPSON STATE OFFICE BUILDING 920 COLORADO AUSTIN, TEXAS 78701 (512) 463-2211 (512) 475-2886 (FAX)

### Landscaping Requirements

CITY OF COPPELL LANDSCAPE REQUIREMENTS ARTICLE 34. LANDSCAPE REGULATIONS PD REQUIREMENTS

SEC. 12-34-8 MIN REQUIREMENTS FOR OFF-STREET PARKING AND VEHICULAR USE AREAS A. PROPERT IS EXEMPT BY MEETING EXEMPTION PARAGRAPH I ARTICLE A AND B


INTERIOR LANDSCAPING REQUIREMENTS A. SCREENING OF PARKING B. SCREENING OF A/C UNITS

PERIMETER LANDSCAPE REQUIREMENTS A. ALL TREE REQUIREMENTS MET VIA STREET LANDSCAPE NO EXISTING TREES ON SITE.

# Irrigation Requirements

UNDERGROUND AUTOMATIC SPRINKLING SYSTEM PROVIDED. SYSTEM DESIGNED AND INSTALLED ACCORDING TO TCEO LAWS AND REGULATIONS PROVIDING FOR 100% COVERAGE ON ALL LANDSCAPE AND TURF. THE SYSTEM SHALL INCLUDE A FREEZE-RAIN SENSOR.

## Site Location



OWNER GARY (EAMER 214 673.999 ILANDSCAPE ARCHITECT WILLIAM PECK & ASSOCIATES, INC. LEWINYLLE, TEXAS 972.221.1424 972.221.1424 CAROL FELDMAN, 972-523-0494 CAROL FELDMAN, 972-523-0494 CAROL FELDMAN, 972-523-0494

LANDSCAPE PLAN

	*	FELDMAN			P.O. Box 852546, Richardson, Texas 75085	Mobile: 972 525-4944	card@feldmandesign.com		
	DATE:	5.14.21	6.3.21	6.4.21					
	ITEM DESCRIPTION	PLAN SUBMITTAL	REVISED PER COMMENTS	MINOR CITY COMMENTS - REVISED					
_	NO.	-	2.	Ŀ.	4.	ы.	Ö	7.	L
	-	6	i.	*			*		
Ca	be	ese en der gis chit æns #20	dr pre		Second upe	-	ve or <del>i</del> on		
	be un of Re Ar Lic	#20	dr pre th	Personal Strength Str	Second upe	hoy	ve or ion ape		

# Exhibit C Page 2 of 3

- SECTION 02910 SOIL PREPARATION PART 1 CENERAL A. DESCRIPTION A. DESCRIPTION AMENDMENTS, AS SPECIFIED HEREIN. B. EXAMINATION 1. EXAMINE SITE TO VERIFY TREQUIRED ROUGH GRADING HAS BEEN COMPLETED CORRECTLY PRIOR TO BED PREPARATION WORK. 2. EXAMINE SITE TO VERIFY THAT ALL INVASIVE PLANTS AND THEIR ROOTS HAVE BEEN REMOVED PRIOR TO BED REPARATION WORK. C. APPROVALS
- APPROVALS. C. APPROVALS 1. ALL 'APPROVED EQUAL' MATERIALS MUST BE APPROVED BY LANDSCAPE ARCHITECT
- PART 2 PRODUCTS

- RT 2 PRODUCTS MATERIALS
  COMPOST:
  1. COTTON BUR COMPOST
  1.2. SHALL BE SUPPLED BY: GREENSENSE COMPOST, GARLAND, TX. OR, CLEAR FORK MATERIALS, ALEDO, TX, OR APPROVED EQUAL.
  2. FERTULZERS AND SUPPLEMENTS:
  2.1. A 6-2-4 GRANULAR FERTULZER WITH A WATER SOLUBLE SLOW RELEASE ORGANIC BASE SUCH AS GREENSENSE, OR SUSTANE. OR APPROVED EQUAL.
  3. MULCH
- APPROVED EXONE. MUCH 1. SHALL BE SHREDDED HARDWOOD MULCH, SHREDDED CEDAR MULCH, SHREDDED NATIVE MULCH, OR APPROVED EQUAL. 3. M 3.1.
- PART 3 EXECUTION A. BED PREPARATION AND PREPARATION FOR SOD INSTALLATION 1. GENERAL
- NERAL INSPECT ALL EXISTING CONDITIONS AND OTHER ITEMS OF WORK PREVIOUSLY COMPLETED. DO NOT PROCEED UNTIL DEFECTS ARE 1.1.
- CORRECTED. 1.2. INSPECT THAT ALL INVASIVE PLANTS AND THEIR ROOTS HAVE BEEN

- INSPECT THAT ALL INVASIVE PLANTS AND THEIR ROOTS HAVE BEEN REMOVED COMPLETELY.
   ALL AREAS TO BE PREPARED WITH ORGANIC TECHNIQUES ONLY.
   SHRUB BEDS:
   BREAK UP AND TILL EXISTING SOIL TO A DEPTH OF 6 INCHES,
   BREAK UP AND TILL EXISTING SOIL TO A DEPTH OF 6 INCHES,
   TILE EXISTING SOIL AND COMPOST TO THE BEDS,
   TILE EXISTING SOIL AND COMPOST TO THE BEDS,
   TILE EXISTING SOIL AND COMPOST TO THE BEDS,
   TOP-DRESS BED WITH A 3 INCH LAYER OF MULCH AFTER PLANTING.
   SOD AND SEED AREAS
   LIGHTLY CULTIVATE COMPACTED SOIL AND RAKE THE SOIL SMOOTH.
   AND SEED ATE COMPACTED SOIL AND RAKE THE SOIL SMOOTH.
   FINE GRADE TO DRAIN IN APPROPRIATE DIRECTIONS.

### END OF SECTION 02910

## NOTES GENERAL LANDSCAPE

I. LANDSCAPE CONTRACTOR IS RESPONSIBLE FOR LOCATING ALL UNDERGROUND UTILITIES AND STRUCTURES WHETHER OR NOT SHOWN ON THE PLANS, AND SHALL BE RESPONSIBLE FOR DAMAGE TO SAND UTILITIES OR STRUCTURES CAUSED BY HIS/HER CREW AND SUBCONTRACTORS.

2. NO PLANTING TO TAKE PLACE UNTIL OWNER HAS INSPECTED AND APPROVED THE BED PREPARATION.

NO PLANTING TO TAKE PLACE UNTIL OWNER HAS INSPECTED AND APPROVED ALL PLANT MATERIAL AND ALL PLANT PLACEMENT. FIELD ADJUSTMENTS OF PLANT LOCATIONS TO BE COORDINATED WITH OWNER. 4. ALL CANOPY AND ORNAMENTAL TREES TO BE STAKED (SEE DETAIL.)

- SECTION 02910 ROOT BARRIER PART 1 GENERAL A. DESCRIPTION A. PROVIDE ROOT BARRIER TO PROTECT FUTURE ROOT GROWTH FROM DAMAGING CONCRETE.
- в. APPROVALS 1. ALL 'APPROVED EQUAL' MATERIALS MUST BE APPROVED BY OWNER.

- PART 2 PRODUCTS A. MATERIALS 1. ROOT BARRIER 1.1. CENTURY PRODUCTS USA MODEL CR-PE 3-20 OR EQUIVALENT AS APPROVED BY OWNER

PART 3 - EXECUTION 1.2. INSTALL ROOT BARRIER 1" BELOW CURB TOP AS PER MANUFACTURES SPECIFICATIONS. ROOT BARRIER TO BE INSTALLED AT CONCRETE EDGE NEXT TO ALL PUBLIC STREETS.

END OF SECTION 02910


- SECTION 02915 LANDSCAPE PLANTING.
  PART 1 GENERAL
  A. SPECIAL CONDITIONS
  1. COMPLY WITH APPLICABLE FEDERAL, STATE, COUNTY AND LOCAL REGULATIONS GOVERNING LANDSCAPE MATERIALS AND WORK.
  2.EMPLOY ONLY EXPERIENCE PERSONNEL FAMILIAR WITH REQUIRED WORK.
  2.EMPLOY ONLY EXPERIENCE PERSONNEL FAMILIAR WITH REQUIRED WORK.
  2.BON DOT MAKE SUBSTITUTIONS OF TREE. SHRUB AND GRASS MATERIALS. IF REQUIRED MATERIAL IS NOT OBTAINABLE, SUBMIT PROOF OF NON-AVAILABILITY TO OWNER'S REPRESENTATIVE.
  4.PROVIDE QUANTITY, SIZE, GENUS, SPECIES AND VARIETY OF TREES AND SHRUBS INDICATED AND SCHEDULED FOR LANDSCAPE WORK WHICH COMPLEXITY
  5.DO NURSERY STOCK, AND ANY APPLICABLE STATE AND STANDARD FOR NURSERY STOCK, APPROVED NOV. 6, 1996 BY AMERICAN STANDARD FOR NURSERY STOCK, APPROVED NOV. 6, 1996 BY AMERICAN STANDARD STANDARDS SISTITUTE, INC.
  2.SHINKERS & MATLERS, INSTITUTE, INC.
- ADMINISTRATE STANDARDS INSTITUTE, INC. 2.SHINNERS & MAHLER'S ILLUSTRATED FLORA OF NORTH CENTRAL TEXAS, BOTANICAL RESEARCH INSTITUTE OF TEXAS (BRIT), FORT WORTH, TEXAS, 1999. 3.HORTUS THIRD, CORNELL UNIVERSITY, 1967.
- C PREPARATION
- C. DREPARATION
  C. DREPARATION
  WITH, CONRULE UNIVERSITI, 1907.
  4. COORDINATION WITH BUILDING AND ENGINEERING PROJECT ACTIVITIES.
  5. COORDINATE THE WORK OF THIS SECTION WITH THAT OF REGULAR AND EMERGENCY WATER UTILITY ACTIVITIES ON THE SITE.
  6. COORDINATION WITH IRRIGATION SYSTEM
  6.1. THE UNDERGROUND IRRIGATION SYSTEM MUST BE INSTALLED PRIOR TO COMMENCEMENT OF THE PLANTING OPERATIONS.
  6.2. THE IRRIGATION SYSTEM SHALL BE OPERATIONAL AT THE TIME THAT PLANTING OPERATIONS COMMENCE.
  6.3. COORDINATE WORK WITH THE IRRIGATION CONTRACTOR TO PREVENT DAMAGE TO THE IRRIGATION SYSTEM.
  D.ALL PLANT MATERIALS FOR THIS PROJECT SHALL BE NURSERY-GROWN, INCLUDING TREES.


- ALL PLANI MATEMALS FOR THIS PROJECT SHALL BE NURSERY-GROWN, INCLUDING TREES. 1. CONTAINER GROWN PLANTS SHALL HAVE BEEN STEPPED-UP AS NECESSARY TO PREVENT ROOT GIRDLING. 2. CONTAINER GROWN PLANTS SHALL HAVE BEEN IN THE CONTAINER FOR A MINIMUM OF SIX (6) MONTHS PRIOR TO DELIVERY TO THE SITE TO ENSURE ADEQUATE ROOT DEVELOPMENT.
- 3. THE 'ROOT FLARE' OF ALL TREES AND SHRUBS SHALL NOT BE COVERED
- 3.THE 'ROOT FLARE' OF ALL TREES AND SHRUBS SHALL NOT BE COVERED WITH SOL
  E.THE FOLLOWING TREE CARE PROCEDURES SHALL BE ADHERED TO:
  1.DO NOT MAKE FLUSH CUTS OR LEAVE STUBS WHEN PRUNING. LEAVE THE BRANCH COLLAR INTACT.
  2.DO NOT USE ANY TYPE OF PRUNING PAINT ON WOUNDS.
  3.DO NOT USE ANY TYPE OF TREE WRAP, EXCEPT, TRUNKS MAY BE WEAPPED WITH BURLAP DURING PLAINING OPERATIONS ONLY.
  4.DO NOT STAKE OR GUY ANY TREES. IN SPECIAL CASES, TREE STAKING MAY BE INCESSARY TO PRESERVE A TREE THAT CONTINUES TO BLOW OVER. THE CONTRACTOR WILL BE RESPONSIBLE FOR ANY TREES THAT NEED STAKING FOR A PERIOD OF ONE YEAR.
  5.DO NOT HANDLE ANY TREE BY ITS TRUNK. ANY TREE HANDLED IN SUCH A MANNER SHOULD BE REJECTED.
- F. WARRANTER
- ARRANTEE 1. UNCONDITIONALLY WARRANT ALL PLANTS FOR A PERIOD OF ONE (1) YEAR AFTER THE DATE OF INSTALLATION INITIAL ACCEPTANCE. REPLACE MATERIALS NOT IN YEGOROUS, THRIVING CONDITION AS SOON AS WEATHER PERMITS AFTER NOTFICATION BY OWNERS THAT THE PLANTS HAVE DIED OR ARE OTHER WISE NOT ACCEPTABLE. GUARANTEE REPLACEMENT PLANTS FOR ONE YEAR, STARTING FROM THE DATE REPLACEMENT IS NATE MADE
- 2.WARRANTY EXCLUDES REPLACEMENT OF PLANTS BECAUSE OF INJURY BY STORM, NATURAL DROUGES REFERCEMENT OF TRANS BECAUSE OF INCOMENTED STORM, NATURAL DROUGHT, DROWNING, HAIL FOR FREEZING, IMATERIAL, AND IN THE OPINION OF THE OWNER'S REPRESENTATIVE THAT THE PROBLEM OCCURRED AFTER THE DATE OF INITIAL ACCEPTANCE.


- PART 3 EXECUTION A. PREPARATION FOR PLANT MATERIAL INSTALLATION 1. EXAMINE THE SUB-GRADE UPON WHICH THE WORK IS TO BE PERFORMED, VERIFY GRADE ELEVATIONS AND VERIFY THAT BEDS HAVE BEEN LEFT LOW BY OTHER TRADES. OBSERVE THE CONDITIONS UNDER WHICH THE WORK IS TO BE PERFORMED AND CONFIRM THAT UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED PRIOR TO PROCEEDING.
  - WILDT THE WORK IS TO BE PERFORMED AND CONFIRM THAT UNSATISFACTORY CONDITIONS HAVE BEEN CORRECTED PRIOR TO PROCEEDING. ITME OF PLANTING CARE IS TO BE TAKEN SO THAT NO PLANTS SIT IN POTS IN THE SUMMER HEAT FOR MORE THAN I HOUR. IF PLANTING DURING HOT SEASONS (NOT PREFERRED) PLANTING IS TO BE DONE IN SMALL SECTIONS WITH STOCKFILLED PLANTS TO BE PROTECTED FROM THE SUMMER HEAT (SHADE AREAS). TREE PLANTING STAKE LOCATIONS FOR TREES PRIOR TO DIGGING HOLES. DIG PTS WITH ROUGH SIDES AND WHICH HAVE TAPERED WALLS, A MINIMUM OF TWICE THE WIDTH OF THE TREE BALL. A PEDESTAL SHOULD BE LEFT IN THE CENTER OF THE HOLE AND THE TREE BALL SET UPON THAT PEDESTAL. SET PLANTS IN THE CENTER OF THE HOLE AND THE THEE BALL SET UPON THAT PEDESTAL. UN AND VERTICAL, AND AT SUCH A DEPTH THAT THE CROWN OF THE TREE BALL WILL BE LEVEL WITH THE SURROUNDING GRADE. 4. ALL PLANTS SHALL BE SET TO MEET THE SAME RELATIONSHIP TO THE FINISHED GRADE OF THE SURROUNDING SOUL THAT THEY BORE TO PREVIOUS EXISTING GRADE OF SOUL. 5. BACKFILL WITH EXISTING TOPSOL 1. INSTALL TREE STAPLES AS PER MANUFACTURE SPECIFICATIONS ON THE NORTH AND SOUTH SIDES OF ROOT BALL. THE LONGER SIDE OF THE STAPLE TO BE ANCHORED DUTSIDE OF THE ROOT BALL. 4. ALL PLANTS SHALL BE SET TIO THE ROOT BALL. 5. MORTH AND SOUTH SIDES OF ROOT BALL. THE LONGER SIDE OF THE STAPLE TO BE ANCHORED DUTSIDE OF THE ROOT BALL. 4. WATER IMMEDIATELY AFTER PLANTING. 6. COVER ALL TREE BALLS WITH A MINIMUM OF 3 OF SPECIFIED MULCH. EXTEND MULCH OUT TO THE EDGE OF THE ROOT BALL. 7. WATER IMMEDIATELY AFTER PLANTING. 7. COVER ALL TREE BALLS WITH A MINIMUM OF 3 OF SPECIFIED MULCH. EXTEND MULCH OUT TO THE EDGE OF THE TREE PIT, BUT KEEP AWAY FROM TRUNKS. 7. REMOVE CONTAINER AND SET PLANTI MATERIAL AT SUCH A LEVEL THAT AFTER SETLEMENT, THE CROWN OF THE BALL WILL BE AT FINISHED GRADE. 7. REMOVE CONTAINER AND SET PLANT MATERIAL AT SUCH A LEVEL THAT AFTER SETLEMENT, THE CROWN OF THE BALL BE AT FINISHED GRADE. 7. GENTLY CUIL OUTER ROOTS OF ANY ROOTBALLS THAT HAVE

- GENTLY CUT OUTER ROOTS OF ANY ROOTBALLS THAT HAVE 2 POT-BOUND PRIOR TO INSTALLATION. 3. COVER PLANTING BEDS WITH A MINIMUM 3 LAYER OF SPECIFIED MULCH.
- COVER PLANTING BEDS WITH A MINIMUM 3 LAYER OF SPECIFIED MULCH. SOD PLANTING
   LAY SOD IN AN ORDERLY MANNER TO COVER ALL BARE SOIL AREAS.
   WATER ALL AREAS OF THE SOD UNTIL THOROUGHLY WET.
   ROLL SOD WITH A SOD ROLLER AFTER 24 HOURS AFTER LAYING AND WATERING SOD TO OBTAIN A UNIFORM, SMOOTH FINISH.
   FILL JOINTS WITH COMPOST IF NECESSARY TO FORM A UNIFORM CRASS LAYER.
   KEEP SOD ADEQUATELY WATERED UNTIL SOD MAKES A FIRM CONNECTION TO THE SOIL.


END OF SECTION 02915

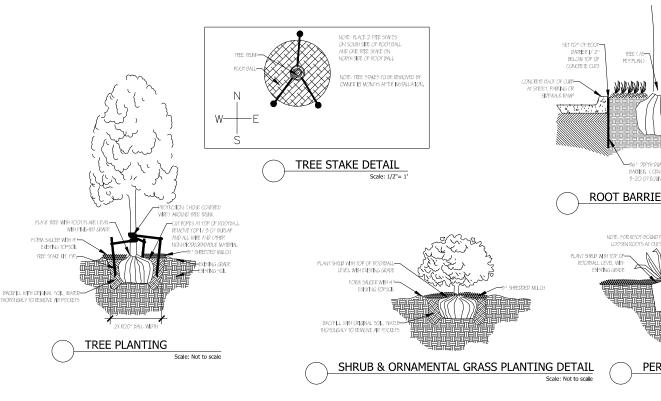

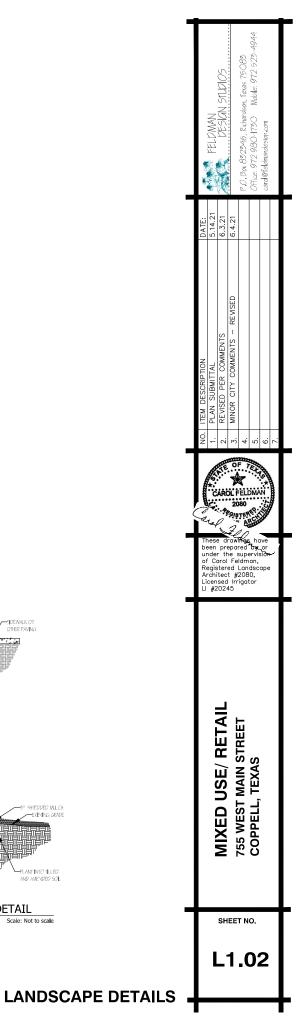



OR SHRLPS ( A



PERENNIAL PLANTING DETAIL

### Exhibit C Page 3 of 3 SECTION 02810 - IRRIGATION

- 1. IRRIGATION SYSTEM MUST BE INSTALLED BY LICENSED IRRIGATOR.
- IRRIGATION CONTRACTOR WILL SECURE ALL REQUIRED PERMITS AND PAY ALL ASSOCIATED FEES UNLESS OTHERWISE NOTED. 2.
- COORDINATE IRRIGATION INSTALLATION WITH PLANTING PLAN AND SITE CONDITIONS TO PROVIDE COMPLETE COVERAGE. THE IRRIGATION CONTRACTOR SHALL MAKE MINOR ADJUSTMENTS TO ENSURE PROPER COVERAGE AT NO ADDITIONAL COST TO OWNER. 3.
- VALVE BOXES SHALL BE INSTALLED FLUSH WITH GRADE, SUPPORTED BY BRICKS IF NEEDED, WITH 3 INCHES OF CLEAN PEA GRAVEL LOCATED BELOW THE VALVE. 4.
- DRIP IRRIGATION SYSTEM IN BEDS TO BE INSTALLED AT GRADE WITH 2" MULCH FULLY COVERING ALL LINES. 5.
- DRIP IRRIGATION SYSTEM IN TURF AREAS IS TO BE INSTALLED SUBSURFACE. FILL TURF AREAS TO A GRADE DEPTH OF MINUS 6" AND LAY LINES. COVER WITH PLANTING SOIL & SOD SO THAT DRIP REMAINS BURIED 6" BELOW GRADE. 6.
- LI.C. SHALL SELECT MPR SERIES SPRAY NOZZLES FOR 'HEAD-TO-HEAD' COVERAGE, ADJUSTED FOR MINIMUM OVERSPRAY ONTO WALLS, FENCES AND WALKS. NO OVERSPRAY INTO STREET IS PERMITTED. 7.
- AND WALKS. NO OVERSPRAY INTO STREET IS PERMITTED.
  IRRIGATOR MUST ABIDE BY THE CITY IRRIGATION CODES, INCLUDING, BUT NOT LIMITED TO THE FOLLOWING:
  RAIN AND FREEZE SENSOR INSTALLED
  PURPLE PRIMER MUST BE USED ON ALL PVC JOINTS.
  IRRIGATION MYSTEM SED ON ALL PVC JOINTS.
  IRRIGATION MYSTEM SEQUEST AN INSPECTION FROM THE CITY WHEN COMPLETE, AND MUST PROVDE: COPY OF MAINTENANCE CHECKLIST REQUIRED BY TCEO CODES AND COPY OF TEST RESULTS OF THE BACKFLOW PREVENTION ASSEMBLY.
  PLANS MUST BE ON SITE DURING INSTALLATION AND INSPECTION.
  PLANS MUST BE ON SITE DURING INSTALLATION AND INSPECTION.
  PLANS MUST BE ON SITE DURING INSTALLATION AND INSPECTION.
  AN TAS-BUILT' DRAWING AND RUN SCHEDULE MUST BE PRODUCED AND A COPY GIVEN TO THE LANDOWNER.
  A PERMANENT STICKER WITH IRRIGATOR'S NAME, LICENSE NUMBER, COMPANY NAME, TELEPHONE NUMBER AND THE DATE OF WARRANTY PERICOD SHALL BE AFFINED TO SACH AUTOMATIC CONTROLLER INSTALLED BY THE IRRIGATOR 8.1. 8.2. 8.3. 8.4.

6-

- 8.5. 8.6.
- 8.7.
- 8.8.
- CONTRACTOR TO PROVIDE THE FOLLOWING FOR CITY INSPECTION: ALL REQUIRED VALVE BOXES SHALL BE INSTALLED, THE LID OF THE VALVE BOX SHALL BE LEFT OPEN UNTIL APPROVED BY THE CODE OFFICIAL. 9. 9.1.
- VALVE BOX SHALL BE LEFT OPEN UNTIL APPROVED BY THE CODE OFFICIAL. PIPING AN VALVES INCLUDING ISOLATION VALVES, WYE STRAINERS, BACKFLOW PREVENTERS, AND MASTER VALVES SHALL BE LEFT UNCOVERED FROM THE POINT OF CONNECTION TO A POINT OF THREE (3) FEET DOWN STREAM OF THE MASTER VALVE AND PRESSURIZED. ALL WRING SPLICES SHALL BE LEFT UNCOVERED OR IF THERE ARE NO SPLICES WIRING MAY BE COVERED TO A POINT WITHIN TWO (2) FEET OF ANY VALVES. ALL ZONE VALVES AND MASTER VALVES SHALL NOT BE CONCEALED FOR A SPACE OF TWO (2) FEET AND UP AND DOWN STREAM OF THE VALVE. INCLUDING THE PIPING CONNECTIONS TO THE VALVE. THE LAST EMISSION DEVICE WITH THE GRAFTEST DEVELOPED LENGTH FROM THE POTABLE WATER SOURCE SHALL BE LEFT EXPOSED FOR A DISTANCE OF TWO (2) FEET FOR INSPECTION AND TESTING. 9.2.
- 9.3.
- 9.4.
- 9.5.

